

Y04/YL4(Xenon) - YL4(LED) INSTALLATION INSTRUCTIONS

Installation: The sounder or combined Sounder Beacon units can be affixed to most surfaces using the back box supplied separately.

Supply input: Ensure that the supply is correct for the voltage rating of the sounder or combined sounder strobe being installed. Ensure that the supply is OFF before making any connection and wire only in accordance with the terminal label detail.

Sound selection: Ensure the supply is OFF before proceeding. All dc and ac sounder units have selectable alarm sounds (see table below for details) and are selectable by means of a 5 way dill switch SW1. A second sound is made available upon the application of a third wire connected to terminal TB1/3 as shown in Fig. 1 while still connected to terminal TB1/2. Alternatively 1st and 2nd stage sound signals can be generated by supply reversal (FOR DC UNITS ONLY) see Fig. 2. Independent second stage sound is available by using SW2 (OPTIONAL- only fitted with orders).

WARNING - Loud alarm sound. Wear ear defenders when testing, installing and commissioning.

- HIGH VOLTAGES ARE PRESENT WITHIN THE BEACON WHEN OPERATIONAL (Xenon Type)

SOUND SELECTION TABLE

	<i>First Stage Sound</i>	<i>frequency Hertz</i>	<i>rept. rate</i>	<i>Second Stage</i>	<i>switches 1 2 3 4 5</i>	<i>Special Application</i>
#	1 Alternate two-tone	800-1000	0.5	3	1 1 1 1 1	Fire Alarms
	2 Alternate two-tone	2500-3100	0.5	4	0 1 1 1 1	Security Alarms
	3 Alternate fast two-tone	800-1000	0.25	7	1 0 1 1 1	Increased urgency
	4 Alternate fast two-tone	2500-3100	0.25	8	0 0 1 1 1	Security deterrent
#	5 Alternate two-tone	440-554	0.4/0.1	14	1 1 0 1 1	AFNOR, France
	6 Alternate two-tone	430-470	1.0	14	0 1 0 1 1	
	7 Alternate v.fast two-tone	800-1000	0.13	12	1 0 0 1 1	
	8 Alternate v.fast two-tone	2500-3200	0.07	13	0 0 0 1 1	
	9 Alternate two-tone	440-554	2.0	10	1 1 1 0 1	Turn-out, Sweden
	10 Continuous note	700	-	1	0 1 1 0 1	All-clear, Sweden
#	11 Continuous note	1000	-	31	1 0 1 0 1	
	12 Continuous note	1000	-	7	0 0 1 0 1	
	13 Continuous note	2300	-	2	1 1 0 0 1	
	14 Continuous note	440	-	9	0 1 0 0 1	
#	15 Interrupted tone	1000	2.0	31	1 0 0 0 1	
#	16 Interrupted tone	420	1.25	30	0 0 0 0 1	AS2220, Australia
	17 Interrupted tone	1000	0.5	1	1 1 1 1 0	
	18 Interrupted tone	2500	0.25	4	0 1 1 1 0	
	19 Interrupted tone	2500	0.5	2	1 0 1 1 0	
	20 Interrupted tone	700	6/12	10	0 0 1 1 0	Pre-vital mess, Sweden
	21 Interrupted tone	1000	1.0	32	1 1 0 1 0	
	22 Interrupted tone	700	4.0	10	0 1 0 1 0	Air-raid, Sweden
	23 Interrupted tone	700	0.25	10	1 0 0 1 0	Local warning, Sweden
	24 Interrupted tone	720	0.7/0.3	10	0 0 0 1 0	Industrial alarm, Germany
	25 Int,fast,rising volume	1400	0.25	26	1 1 1 0 0	
	26 Fast siren	250-1200	0.085	11	0 1 1 0 0	
	27 Rising constant, fall	1000	10/40/10	17	1 0 1 0 0	Industrial alarm, Germany
#	28 ISO 8201 Evacuation	800-1000	as std	11	0 0 1 0 0	Int'l evacuation alarm
	29 Fast whoop	500-1000	0.15	32	1 1 0 0 0	
#	30 Slow whoop	500-1200	4.5	12	0 1 0 0 0	Evacuation, The Netherlands
#	31 Reverse sweep	1200-500	1	11	1 0 0 0 0	Evacuation, Germany
	32 Siren	500-1200	3.0	26	0 0 0 0 0	

switch settings: ON=1 and OFF=0

- Tones approved to BSEN54 Part3


The PFEER sound signals recommended by UKOOA are:-

General Alarm	Sound Signal 15	Interrupted tone 1000 Hz
PAPA	Sound Signal 31	Reverse Sweep 1200-500 Hz
Toxic Gas	Sound Signal 11	Continuous Tone 1000 Hz.

MOUNTING: The Y04/YL4 V4 & YL4(LED) series alarm units are supplied separate from the back box. The back box should be mounted to a suitable surface or to a standard wiring box using any of the mounting holes. 20mm cable entries are provided on all sides and in the base. To maintain the integrity of the weather seal, the cable entry must be via a suitable sealed gland.

SOUNDERS


FIGURE 1: DC INPUT

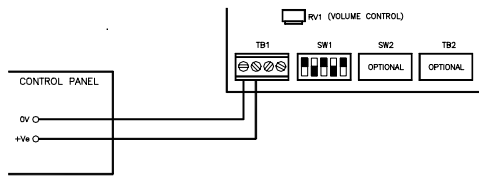

LINE INTEGRITY ON DC SYSTEMS
 - FOR 3 WIRE 2 STAGE ALARM SYSTEM,
 MONITOR VIA REVERSE POLARITY- FOR 2 WIRE 2 STAGE
 ALARM SYSTEM,
 MONITOR VIA THRESHOLD (APPLIED VOLTAGE < 1V)
 AN END-OF-LINE (E.O.L) RESISTOR IS REQUIRED FOR LINE
 MONITORING AND IT SHOULD BE A MINIMUM RESISTANCE OF
 3K3 OHMS AND 0.5WATTS, WIRE-WOUND OR METAL FILM TYPE

FIGURE 2: DC INPUT

2nd STAGE WITH THIRD WIRE

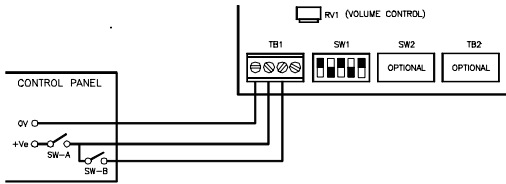

2nd STAGE BY SUPPLY REVERSAL



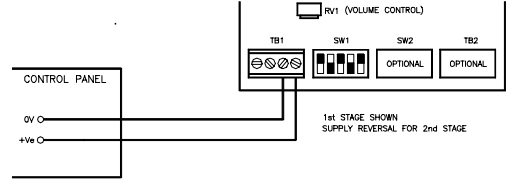


FIGURE 3: AC INPUT

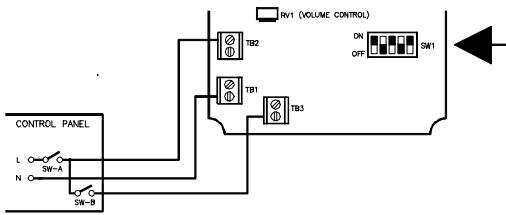

SOUND
SELECTION


FIGURE 4: SYSTEM CONNECTION

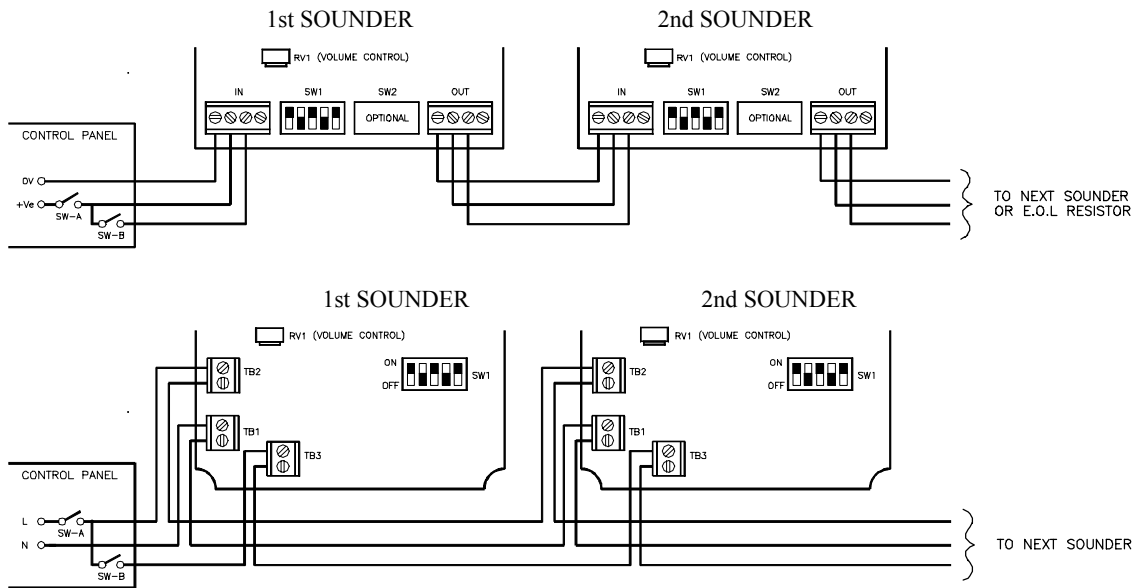

BEACONS: The power supply for the Beacons (Xenon & LED Type) is via the on-board terminal block:

- For DC: Terminal (+) for +ve and Terminal (-) for 0v
- For AC: Terminal (L) for LIVE and Terminal (N) for NEUTRAL (Xenon Beacon Only).
- LED type Beacons are only available in 2/24Vdc

POLAR DIAGRAM OF TONE 11
 (see Website for all other
 EN54-3 approved tones)

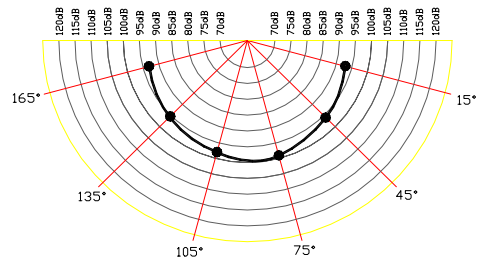

CLIFFORD & SNELL, TOM CRIBB ROAD, THAMESMEAD LONDON SE28 0BH

TEL: 0208 317 1717 FAX: 0208 317 2400

web: cliffordandsnell.com

Email: cliffordandsnell@aol.com